

6

5


7

D

С

A

8

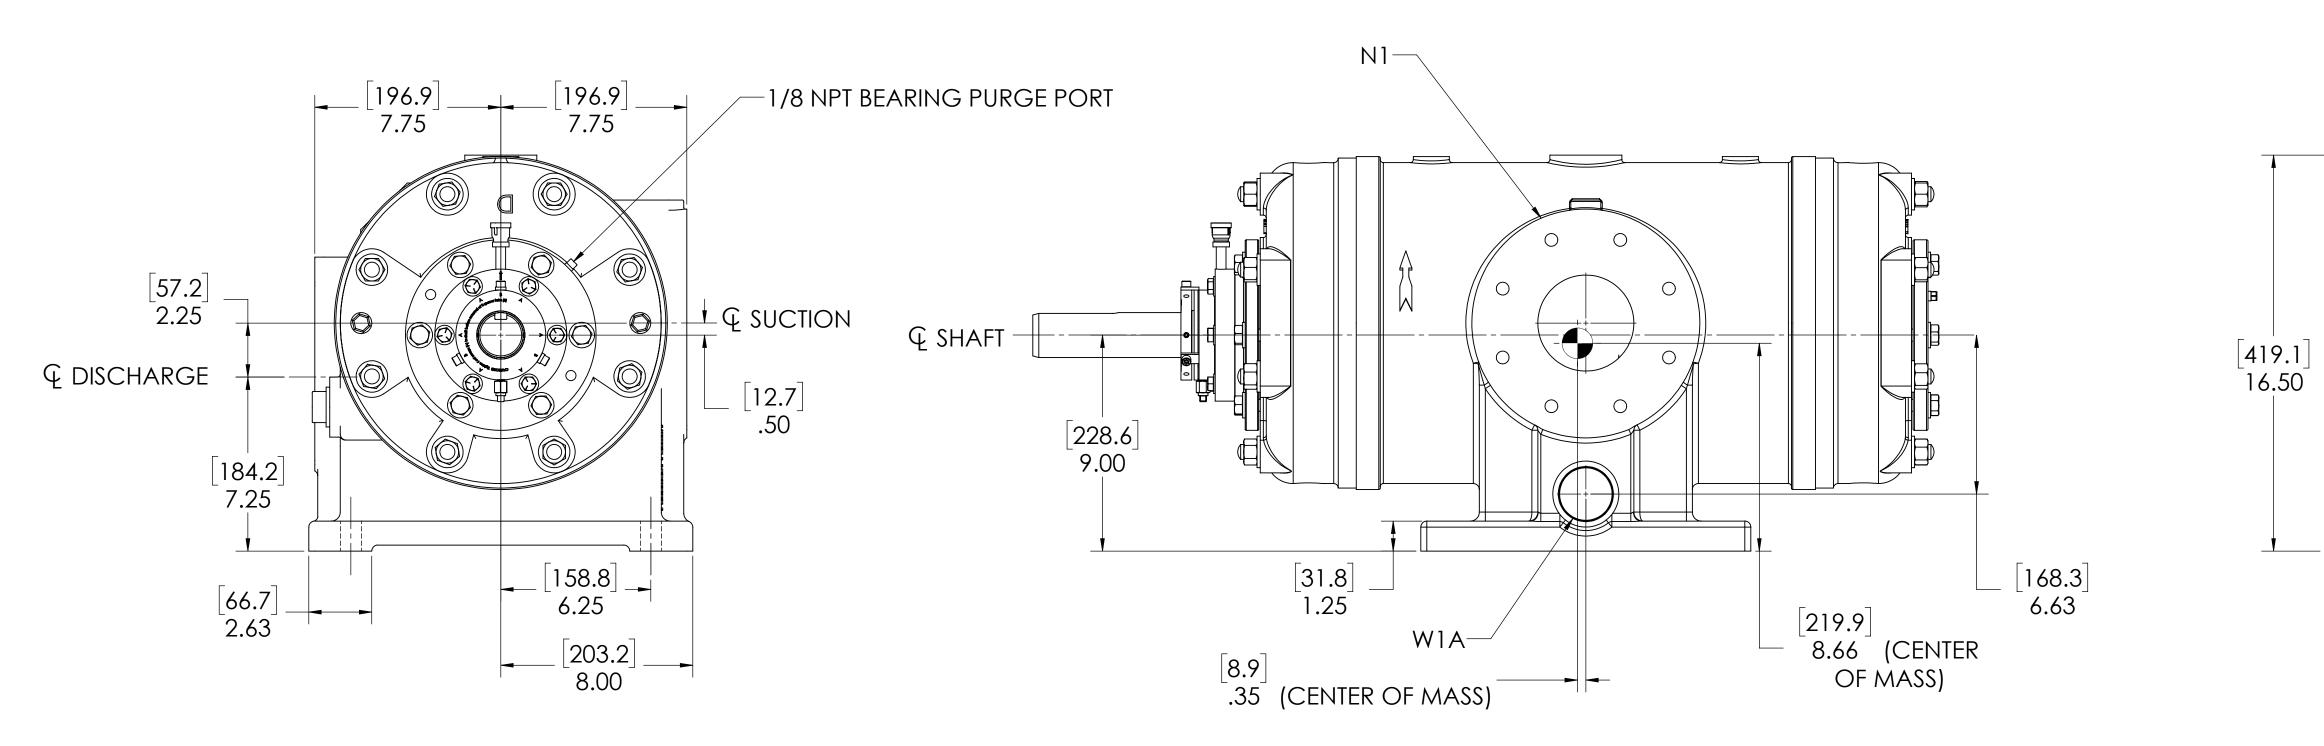

D3—

NOTE 5-


6

NOTES:

8

- 1. - CENTER OF MASS DIMENSIONS ARE APPROXIMATE
- 2. EITHER WATER INLET MAY BE USED, DEPENDING UPON SYSTEM NEEDS
- 3. WEIGHT IS APPROXIMATE
- 4. THIS DRAWING IS DUAL DIMENSION. DIMENSIONS WITHOUT BRACKETS ARE IN INCHES, DIMENSIONS IN [BRACKETS] ARE IN MILLIMETERS.
- 5. REMOVE (3) RED SEAL LOCKING TABS BEFORE OPERATION. RETAIN TABS AND SCREWS FOR SERVICE (TABS MUST BE INSTALLED BEFORE SEAL REMOVAL).

7

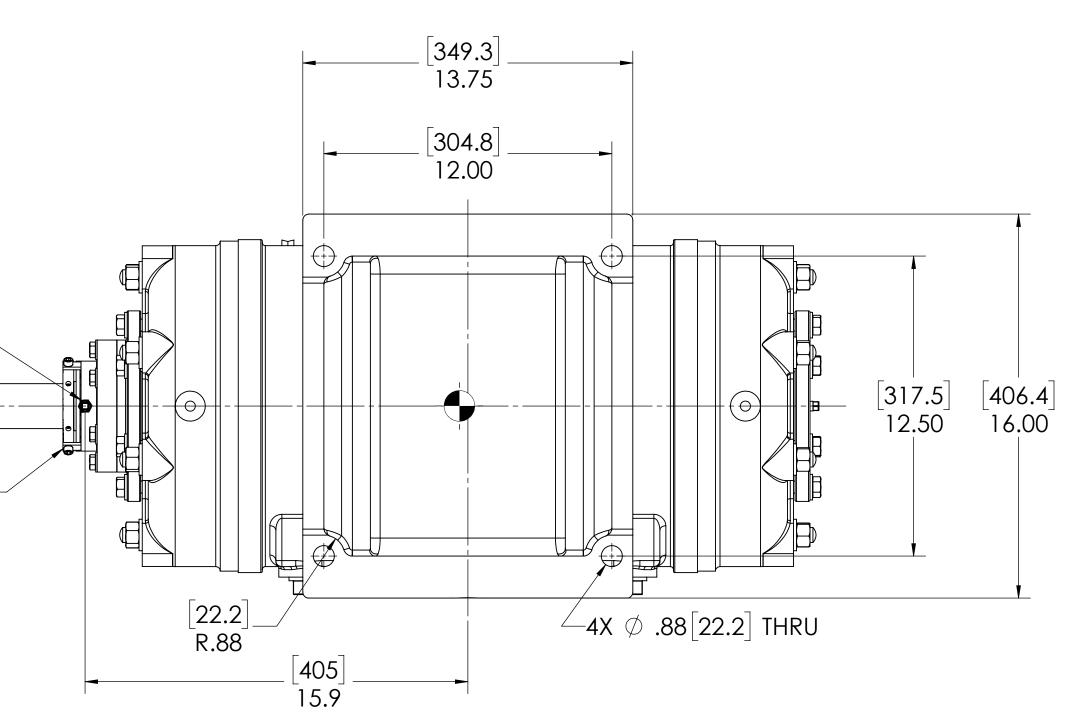

5


4


1/2-13 UNC - 2B $\overline{\vee}$.75[19.1] THIS IS A LIFTING HOLE FOR CYLINDER HEAD (MAINTENANCE) ONLY. DO NOT USE THIS HOLE FOR LIFTING COMPRESSOR!

3

4

[355.6] - 14.00 CLEARANCE REQUIRED TO REMOVE ROTOR BLADES

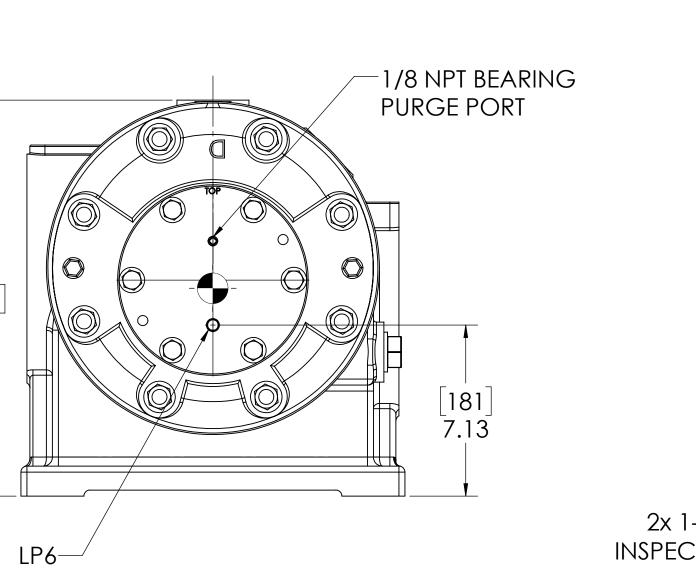


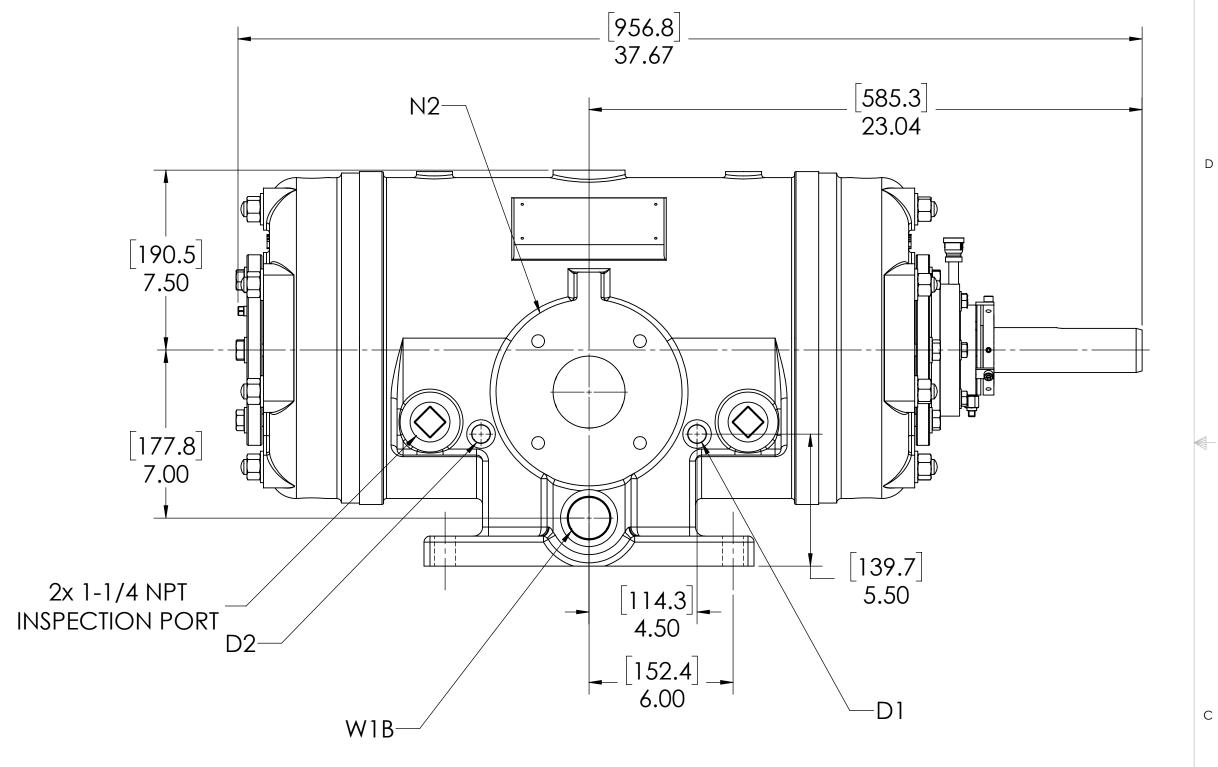

| | NOZZLE CONNECTIONS | BOLT HOLE SIZE | | |
|-----|--|-----------------------|--|--|
| N1 | 4" GAS SUCTION FLANGE (ANSI CLASS 150 FLAT FACE) | 8 x 5/8-11⊽1.00 | | |
| N2 | 3'' GAS DISCHARGE FLANGE (ANSI CLASS 150 FLAT FACE) | 4 x 5/8-11⊽1.00 | | |
| W1A | 2 NPT(F) WATER INLET (SEE NOTE 2) | N/A | | |
| W1B | 1-1/2 NPT(F) WATER INLET (SEE NOTE 2) | N/A | | |
| W2 | 1-1/4 NPT(F) WATER OUTLET | N/A | | |
| D1 | 1/2 NPT (F) DRAIN HOLE | N/A | | |
| D2 | 1/2 NPT (F) DRAIN HOLE | N/A | | |
| D3 | 1/8 NPT (F) SEAL WEEPAGE DRAIN | N/A | | |

3

2

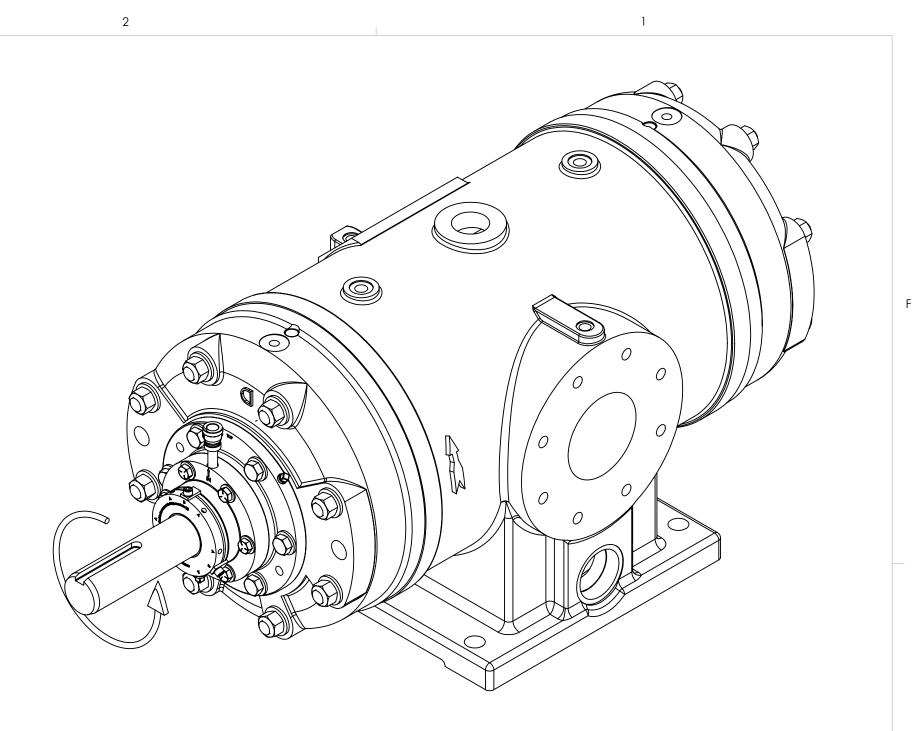

| | | | | CONNE | • | | |
|--|---|---|--|-----------|--------------------------------------|------|--|
| (REFER TO MAN | <u>ANV</u> | LFC | <u>DR Fl</u> | JRTHER IN | VFORMATI | ON) | |
| DESCRIPTION | | THREAD SIZE | | | QTY | QTY | |
| LUBE QUILL(LG | 2) | 1/4 NPT(F) | | 1 | 1 | | |
| LUBE POINTS(LF | 'x) | 1/4 NPT(F) | | 6 | | | |
| | | | | | | | |
| UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN INCHES TOLERANCES: | DRAWN | NAME TRF | DATE | | Ro-Flo | | |
| DIMENSIONS ARE IN INCHES TOLERANCES: ANGULAR: MACH±.5 DEG | DRAWN CHECKED ENG APPR. | TRF TRF | 11/13/2023 11/13/2023 | IIILE: | Ro-Flo | | |
| DIMENSIONS ARE IN INCHES TOLERANCES: | CHECKED ENG APPR. PROPRIETAR THE INFOR | TRF TRF TRF Y AND CO MATION C THIS | 11/13/2023 11/13/2023 11/13/2023 | GENERAL | RO-FIO ARRANGEMED, CCW, SC | ENT, | |

1:4 800 LBS 1 OF 1

В